



# Hilfield Solar Farm and Battery Storage

## Noise Impact Assessment

on behalf of Elstree Green Limited

Prepared by Inacoustic Limited | December 2020 |  
Document Reference: R011





# Hilfield Solar Farm and Battery Storage, Elstree

## Noise Impact Assessment

17<sup>th</sup> December 2020

inacoustic | **bristol**

Caswell Park, Caswell Lane, Clapton-in-Gordano, Bristol, BS20 7RT

0117 325 3949 | [www.inacoustic.co.uk](http://www.inacoustic.co.uk) | [bristol@inacoustic.co.uk](mailto:bristol@inacoustic.co.uk)

inacoustic is a trading name of ABRW Associates Ltd, registered in the UK 09382861

Version	1	2	3
Comments	Noise Impact Assessment	Agent Comments	Finalised Site Layout
Date	16 <sup>th</sup> November 2020	15 <sup>th</sup> December 2020	17 <sup>th</sup> December 2020
Authored By	Neil Morgan MSc MIOA	Neil Morgan MSc MIOA	Neil Morgan MSc MIOA
Checked By	Antony Best BSc (Hons) MIOA	Antony Best BSc (Hons) MIOA	Antony Best BSc (Hons) MIOA
Project Number	20-116	20-116	20-116

This report has been prepared for the titled project or named part thereof and should not be used in whole or part and relied upon for any other project without the written authorisation of the author. No responsibility or liability is accepted by the author for the consequences of this document if it is used for a purpose other than that for which it was commissioned. Persons wishing to use or rely upon this report for other purposes must seek written authority to do so from the owner of this report and/or the author and agree to indemnify the author for any loss or damage resulting there from. The author accepts no responsibility or liability for this document to any other party than the person by whom it was commissioned.

The findings and opinions expressed are relevant to the dates of the site works and should not be relied upon to represent conditions at substantially later dates. If additional information becomes available which may affect our comments, conclusions or recommendations, the author reserves the right to review the information, reassess any new potential concerns and modify our opinions accordingly.

## CONTENTS

1.	INTRODUCTION	5
1.1.	OVERVIEW	5
1.2.	SCOPE AND OBJECTIVES	5
2.	LEGISLATION AND POLICY FRAMEWORK	6
2.1.	NATIONAL POLICY	6
2.2.	ASSESSMENT CRITERIA	9
3.	SITE DESCRIPTION	10
3.1.	SITE AND SURROUNDING AREA	10
3.2.	PROPOSED DEVELOPMENT OVERVIEW	11
4.	MEASUREMENT METHODOLOGY	12
4.1.	GENERAL	12
4.2.	MEASUREMENT DETAILS	12
4.3.	SUMMARY RESULTS	14
5.	OPERATIONAL NOISE ASSESSMENT	15
5.1.	NOISE MODELLING	15
5.2.	ASSESSMENT	18
5.3.	RATING SOUND LEVEL	22
6.	CONCLUSION	26
7.	APPENDICES	27
7.1.	APPENDIX A – DEFINITION OF TERMS	28
7.2.	APPENDIX B – FULL MEASUREMENT RESULTS	31

## FIGURES

FIGURE 1:	SITE LOCATION PLAN	10
FIGURE 2:	PROPOSED DEVELOPMENT LAYOUT	11
FIGURE 3:	MEASUREMENT POSITIONS	14
FIGURE 4:	SPECIFIC SOUND LEVEL MAP	16
FIGURE 5:	MP1 - MEASURED TIME HISTORY	31
FIGURE 6:	MP1 - STATISTICAL ANALYSIS OF $L_{A90}$ BACKGROUND – DAYTIME	32
FIGURE 7:	MP1 - STATISTICAL ANALYSIS OF $L_{A90}$ BACKGROUND – NIGHT-TIME	32
FIGURE 8:	MP2 - MEASURED TIME HISTORY	33
FIGURE 9:	MP2 - STATISTICAL ANALYSIS OF $L_{A90}$ BACKGROUND – DAYTIME	33
FIGURE 10:	MP2 - STATISTICAL ANALYSIS OF $L_{A90}$ BACKGROUND – NIGHT-TIME	34
FIGURE 11:	MP3 - MEASURED TIME HISTORY	34

FIGURE 12: MP3 - STATISTICAL ANALYSIS OF L <sub>A90</sub> BACKGROUND - DAYTIME	35
FIGURE 13: MP3 - STATISTICAL ANALYSIS OF L <sub>A90</sub> BACKGROUND - NIGHT-TIME	35
FIGURE 14: MP4- MEASURED TIME HISTORY	36
FIGURE 15: MP4 - STATISTICAL ANALYSIS OF L <sub>A90</sub> BACKGROUND - DAYTIME	36
FIGURE 16: MP4 - STATISTICAL ANALYSIS OF L <sub>A90</sub> BACKGROUND - NIGHT-TIME	37
FIGURE 17: MP5 - MEASURED TIME HISTORY	37
FIGURE 18: MP5 - STATISTICAL ANALYSIS OF L <sub>A90</sub> BACKGROUND - DAYTIME	38
FIGURE 19: MP5 - STATISTICAL ANALYSIS OF L <sub>A90</sub> BACKGROUND - NIGHT-TIME	38
FIGURE 20: MP6 - MEASURED TIME HISTORY	39
FIGURE 21: MP6 - STATISTICAL ANALYSIS OF L <sub>A90</sub> BACKGROUND - DAYTIME	39
FIGURE 22: MP6 - STATISTICAL ANALYSIS OF L <sub>A90</sub> BACKGROUND - NIGHT-TIME	40

## TABLES

TABLE 1: SIGNIFICANCE CRITERIA FROM NPPG IN ENGLAND: NOISE	8
TABLE 2: INVENTORY OF SOUND MEASUREMENT EQUIPMENT	12
TABLE 3: MEASUREMENT POSITION DESCRIPTION	13
TABLE 4: SUMMARY OF NOISE MEASUREMENT RESULTS	14
TABLE 5: SOUND SOURCE DATA	15
TABLE 6: PREDICTED SPECIFIC SOUND LEVEL SUMMARY	17
TABLE 7: RATING PENALTY ASSESSMENT	19
TABLE 8: MEASUREMENT UNCERTAINTY FACTORS	20
TABLE 9: CALCULATION UNCERTAINTY FACTORS	21
TABLE 10: RATING SOUND LEVELS	22
TABLE 11: DAYTIME BS4142:2014+A1:2019 ASSESSMENT SUMMARY	23
TABLE 12: NIGHT TIME BS4142:2014+A1:2019 ASSESSMENT SUMMARY	24
TABLE 13: TYPICAL SOUND LEVELS FOUND IN THE ENVIRONMENT	29

# 1. INTRODUCTION

## 1.1. Overview

inacoustic has been commissioned to prepare a Noise Assessment Report for a proposed Solar PV and Battery Storage Project on land to the north east and west of Elstree Aerodrome, Hertfordshire.

Accordingly, the following technical noise assessment has been produced to support a Planning Application to Hertsmere Borough Council. This report details the existing background sound climate at the nearest receptors, as well as the potential sound emissions associated with the site layout for the Proposed Development.

This noise assessment is necessarily technical in nature; therefore a glossary of terms is included in Appendix A to assist the reader.

## 1.2. Scope and Objectives

The scope of the report is summarised as follows:

- A sound monitoring survey was undertaken at discrete locations adjacent to the closest noise-sensitive receptors to the site;
- A 3-dimensional noise modelling exercise, in order to quantify the potential noise generation of the proposed site uses;
- An assessment of potential noise impacts with respect to the prevailing acoustic conditions at existing off-site receptors; and
- Recommendation of mitigation measures, where necessary, to comply with the requirements BS4142:2014+A1:2019<sup>1</sup>.

---

<sup>1</sup> British Standard 4142: 2014+A1:2019 *Method for rating and assessing commercial sound*. BSI

## 2. LEGISLATION AND POLICY FRAMEWORK

### 2.1. National Policy

#### 2.1.1. National Planning Policy Framework, 2019

The *National Planning Policy Framework* (NPPF) sets out the Government's planning policies for England. Planning policy requires that applications for planning permission must be determined in accordance with the development plan, unless material considerations indicate otherwise.

The NPPF is also a material consideration in planning decisions. It sets out the Government's requirements for the planning system and how these are expected to be addressed.

Under Section 15; *Conserving and Enhancing the Natural Environment*, in Paragraph 170, the following is stated:

*"Planning policies and decisions should contribute to and enhance the natural and local environment by:*

- e) preventing both new and existing development from contributing to, being put at unacceptable risk from, or being adversely affected by, unacceptable levels of soil, air, water or noise pollution or land instability".*

Paragraph 180 of the document goes on to state:

*"Planning policies and decisions should also ensure that new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environment, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should:*

- a) mitigate and reduce to a minimum potential adverse impacts resulting from noise from new development - and avoid noise giving rise to significant adverse impacts on health and the quality of life;*
- b) identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason."*

As stated above, this document makes reference to avoiding noise generation from new developments that would adversely impact on health and quality of life. Paragraph 180 refers to the Noise Policy Statement for England, which is considered overleaf.

## 2.1.2. Noise Policy Statement for England, 2010

The underlying principles and aims of existing noise policy documents, legislation and guidance are clarified in *DEFRA: 2010: Noise Policy Statement for England* (NPSE)<sup>2</sup>. The NPSE sets out the “*Long Term Vision*” of Government noise policy as follows:

*“Promote good health and good quality of life through the effective management of noise within the context of Government policy on sustainable development”.*

The NPSE outlines three aims for the effective management and control of environmental, neighbour and neighbourhood noise:

- *“Avoid significant adverse impacts on health and quality of life;*
- *Mitigate and minimise adverse impacts on health and quality of life; and*
- *Where possible, contribute to the improvement of health and quality of life”.*

The guidance states that it is not possible to have a single objective noise-based measure that defines “*Significant Observed Adverse Effect Level (SOAEL)*” that is applicable to all sources of noise in all situations and that not having specific SOAEL values in the NPSE provides the necessary policy flexibility until further evidence and suitable guidance is available.

## 2.1.3. National Planning Practice Guidance in England: Noise, 2019

Further guidance in relation to the NPPF and the NPSE has been published in the *National Planning Practice Guidance in England: Noise* (NPPG Noise)<sup>3</sup>, which summarises the noise exposure hierarchy, based on the likely average response. The following three observed effect levels are identified below:

- **Significant Observed Adverse Effect Level:** This is the level of noise exposure above which significant adverse effects on health and quality of life occur;
- **Lowest Observed Adverse Effect Level:** This is the level of noise exposure above which adverse effects on health and quality of life can be detected; and
- **No Observed Adverse Effect Level:** This is the level of noise exposure below which no effect at all on health or quality of life can be detected.

---

<sup>2</sup> Department for Environment, Food and Rural Affairs (DEFRA), 2010. Noise Policy Statement for England. DEFRA.

<sup>3</sup> Department for Communities and Local Government (DCLG), 2019. National Planning Practice Guidance for England: Noise. DCLG.

Criteria related to each of these levels are reproduced in Table 1.

TABLE 1: SIGNIFICANCE CRITERIA FROM NPPG IN ENGLAND: NOISE

Perception	Examples of Outcomes	Increasing Effect Level	Action
<b>No Observed Effect Level</b>			
Not Noticeable	No Effect	No Observed Effect	No specific measures required
<b>No Observed Adverse Effect Level</b>			
Noticeable and Not Intrusive	Noise can be heard, but does not cause any change in behaviour, attitude or other physiological response. Can slightly affect the acoustic character of the area but not such that there is a change in the quality of life.	No Observed Adverse Effect	No specific measures required
<b>Lowest Observed Adverse Effect Level</b>			
Noticeable and Intrusive	Noise can be heard and causes small changes in behaviour, attitude or other physiological response, e.g. turning up volume of television; speaking more loudly; where there is no alternative ventilation, having to close windows for some of the time because of the noise. Potential for some reported sleep disturbance. Affects the acoustic character of the area such that there is a small actual or perceived change in the quality of life.	Observed Adverse Effect	Mitigate and reduce to a minimum
<b>Significant Observed Adverse Effect Level</b>			
Present and Disruptive	The noise causes a material change in behaviour, attitude or other physiological response, e.g. avoiding certain activities during periods of intrusion; where there is no alternative ventilation, having to keep windows closed most of the time because of the noise. Potential for sleep disturbance resulting in difficulty in getting to sleep, premature awakening and difficulty in getting back to sleep. Quality of life diminished due to change in acoustic character of the area.	Significant Observed Adverse Effect	Avoid
Present and Very Disruptive	Extensive and regular changes in behaviour, attitude or other physiological response and/or an inability to mitigate effect of noise leading to psychological stress, e.g. regular sleep deprivation/awakening; loss of appetite, significant, medically definable harm, e.g. auditory and non-auditory.	Unacceptable Adverse Effect	Prevent

## 2.2. Assessment Criteria

### 2.2.1. BS4142:2014+A1:2019

BS4142:2014+A1:2019 sets out a method to assess the likely effect of sound from factories, industrial premises or fixed installations and sources of an industrial nature in commercial premises, on people who might be inside or outside a dwelling or premises used for residential purposes in the vicinity.

The procedure contained in BS4142:2014+A1:2019 for assessing the effect of sound on residential receptors is to compare the measured or predicted sound level from the source in question, the  $L_{Aeq,T}$  'specific sound level', immediately outside the dwelling with the  $L_{A90,T}$  background sound level.

Where the sound contains a tonality, impulsivity, intermittency and other sound characteristics, then a correction depending on the grade of the aforementioned characteristics of the sound is added to the specific sound level to obtain the  $L_{Ar,Tr}$  'rating sound level'. A correction to include the consideration of a level of uncertainty in sound measurements, data and calculations can also be applied when necessary.

BS4142:2014+A1:2019 states: *"The significance of sound of an industrial and/or commercial nature depends upon both the margin by which the rating level of the specific sound source exceeds the background sound level and the context in which the sound occurs"*. An estimation of the impact of the specific sound can be obtained by the difference of the rating sound level and the background sound level and considering the following:

- *"Typically, the greater this difference, the greater the magnitude of the impact."*
- *"A difference of around +10dB or more is likely to be an indication of a significant adverse impact, depending on the context."*
- *"A difference of around +5dB is likely to be an indication of an adverse impact, depending on the context."*
- *"The lower the rating level is relative to the measured background sound level, the less likely it is that the specific sound source will have an adverse impact or a significant adverse impact. Where the rating level does not exceed the background sound level, this is an indication of the specific sound source having a low impact, depending on the context."*





## 4. MEASUREMENT METHODOLOGY

### 4.1. General

The prevailing background noise conditions in the area have been determined by an environmental noise survey conducted during both daytime and night-time periods between Thursday 9<sup>th</sup> and Monday 13<sup>th</sup> July 2020.

The survey was undertaken during the Covid-19 pandemic, meaning that road traffic movements may have been slightly suppressed, giving the dataset used to derive the background sound level statistical robustness.

### 4.2. Measurement Details

All noise measurements were undertaken by a consultant certified as competent in environmental noise monitoring, and, in accordance with the principles of BS 7445<sup>4</sup>. All acoustic measurement equipment used during the noise survey conformed to Type 1 specification of British Standard 61672<sup>5</sup>. A full inventory of this equipment is shown in Table 2 below.

TABLE 2: INVENTORY OF SOUND MEASUREMENT EQUIPMENT

Position	Make, Model & Description	Serial Number
MP1	Rion NL-52 Sound Level Meter	00965097
	Rion NH-25 Preamplifier	65324
	Rion UC-59 Microphone	10223
MP2	Brüel & Kjær 2238 Sound Level Meter	2328256
	Brüel & Kjær ZC 0030 Preamplifier	-
	Brüel & Kjær 4188 Microphone	2274651
MP3	Rion NL-52 Sound Level Meter	00965159
	Rion NH-25 Preamplifier	65386
	Rion UC-59 Microphone	10288
MP4	Rion NL-52 Sound Level Meter	00943360
	Rion NH-25 Preamplifier	43376
	Rion UC-59 Microphone	07154
MP5	Rion NL-31 Sound Level Meter	00531144
	Rion NH-21 Preamplifier	11344
	Rion UC-53A Microphone	308056
MP6	NTi Audio STK2 Sound Level Meter	A2A-14648-E0
	NTi Audio MA220 Preamplifier	7599
	NTi Audio MC230A Microphone	A15871
All	Cirrus CR:515 Acoustic Calibrator	80029

<sup>4</sup> British Standard 7445: 2003: *Description and measurement of environmental noise*. BSI.

<sup>5</sup> British Standard 61672: 2013: *Electroacoustics. Sound level meters. Part 1 Specifications*. BSI.

Measurement equipment used during the survey was field calibrated at the start and end of the measurement period. A calibration laboratory has calibrated the field calibrator used within the twelve months preceding the measurements.

The weather conditions during the survey were predominantly conducive to noise measurement; it being dry, with low wind speeds, as measured on-site with a rain-tipping gauge and anemometer. Where periods of inclement weather did occur, they have been removed from the dataset used to derive the summary results.

The microphone was fitted with a protective windshield for the measurement, which is described in Table 4, with an aerial photograph indicating their location shown in Figure 3.

TABLE 3: MEASUREMENT POSITION DESCRIPTION

Measurement Position	Description
MP1	An unattended daytime and night-time measurement of sound under free-field conditions, at a height of 1.5 metres above local ground level on land associated with the site, in the vicinity of Phillimore House, et-al on Watling Street. The sound environment was maintained by road traffic.
MP2	An unattended daytime and night-time measurement of sound under free-field conditions, at a height of 1.5 metres above local ground level on land associated with the site, in the vicinity of Winterbourne House, at the junction of Aldenham Road and Butterfly Lane. The sound environment was maintained by road traffic.
MP3	An unattended daytime and night-time measurement of sound under free-field conditions, at a height of 1.5 metres above local ground level on land associated with the site, in the vicinity of the residential properties near the junction of Aldenham Road and Wards Lane. The sound environment was maintained by road traffic.
MP4	An unattended daytime and night-time measurement of sound under free-field conditions, at a height of 1.5 metres above local ground level on land associated with the site, in the vicinity of Kendal House. The sound environment was maintained by road traffic.
MP5	An unattended daytime and night-time measurement of sound under free-field conditions, at a height of 1.5 metres above local ground level on land associated with the site, in the vicinity of Hilfield Farm. The sound environment was maintained by road traffic.
MP6	An unattended daytime and night-time measurement of sound under free-field conditions, at a height of 1.5 metres above local ground level on land associated with the site, in the vicinity of the M1 motorway (and representative of properties along this corridor). The sound environment was maintained by road traffic.

FIGURE 3: MEASUREMENT POSITIONS



### 4.3. Summary Results

The summarised results of the environmental noise measurements are presented in Table 4, with full time histories and statistical analyses presented under Appendix B.

TABLE 4: SUMMARY OF NOISE MEASUREMENT RESULTS

Measurement Position	Period	Noise Level, dB			
		L <sub>A</sub> F <sub>max</sub>	L <sub>A</sub> eq,T	L <sub>A</sub> 10	L <sub>A</sub> 90
MP1	Daytime	72	53	56	42
	Night-Time	67	48	51	33
MP2	Daytime	72	53	54	42
	Night-Time	58	41	43	36
MP3	Daytime	66	47	49	40
	Night-Time	66	40	41	33
MP4	Daytime	71	50	52	39
	Night-Time	69	51	53	32
MP5	Daytime	81	61	60	51
	Night-Time	61	50	52	46
MP6	Daytime	80	64	65	58
	Night-Time	69	60	62	51

## 5. OPERATIONAL NOISE ASSESSMENT

### 5.1. Noise Modelling

#### 5.1.1. Source Data

The A-weighted sound power levels associated with the development have been provided by the Applicant and can be seen below in Table 5.

TABLE 5: SOUND SOURCE DATA

Plant	Quantity	Sound Pressure Level, $L_{pA}$ (dB)	Sound Pressure Level Distance (m)
PV Inverters	16	59	10
HVAC for Battery Storage	80	41	10

#### 5.1.2. Calculation Process

Calculations were carried out using iNoise 2020, which undertakes its calculations in accordance with guidance given in ISO9613-1:1993 and ISO9613-2:1996.

#### 5.1.3. Sound Data Assumptions

Given that the land between Proposed Development and nearest receptors is largely soft, the ground factor has been set to 0.8, within the calculation software. In order to accurately model the land surrounding the development, an AutoCAD DXF drawing was produced, which was based on data provided by the Ordnance Survey.

The assessment considers open propagation from the site, with no perimeter acoustic barrier.

### 5.1.4. Specific Sound Level Map

The sound map showing the specific sound level emissions from the Proposed Development can be seen in Figure 4.

FIGURE 4: SPECIFIC SOUND LEVEL MAP



### 5.1.5. Specific Sound Level Summary

A summary of the predicted specific sound levels at the NSRs, based on the sound map shown in Figure 4 can be seen below in Table 6.

TABLE 6: PREDICTED SPECIFIC SOUND LEVEL SUMMARY

NSR	Specific Sound Level (dB)
1	27
2	28
3	29
4	29
5	30
6	37
7	25
8	22
9	24
10	26
11	24
12	27
13	26
14	28
15	29
16	28
17	29
18	32
19	26
20	25
21	29
22	24
23	24

## 5.2. Assessment

### 5.2.1. Rating Penalty Principle

Section 9 of BS4142:2014+A1:2019 describes how the rating sound level should be derived from the specific sound level, by determining a rating penalty. BS4142:2014+A1:2019 states:

*“Certain acoustic features can increase the significance of impact over that expected from a basic comparison between the specific sound level and the background sound level. Where such features are present at the assessment location, add a character correction to the specific sound level to obtain the rating level. This can be approached in three ways:*

- a) subjective method;*
- b) objective method for tonality;*
- c) reference method.”*

Given that the Proposed Development is not operational, the subjective method has been adopted to derive the rating sound level from the specific sound level. This is discussed in Section 9.2 of BS4142:2014+A1:2019, which states:

*“Where appropriate, establish a rating penalty for sound based on a subjective assessment of its characteristics. This would also be appropriate where a new source cannot be measured because it is only proposed at that time, but the characteristics of similar sources can subjectively be assessed.*

*Correct the specific sound level if a tone, impulse or other characteristics occurs, or is expected to be present, for new or modified sound sources.”*

BS4142:2014+A1:2019 defines four characteristics that should be considered when deriving a rating penalty, namely; tonality; impulsivity; intermittency; and other sound characteristics, which are defined as:

#### **Tonality**

A rating penalty of +2 dB is applicable for a tone which is *“just perceptible”*, +4 dB where a tone is *“clearly perceptible”*, and +6 dB where a tone is *“highly perceptible”*.

#### **Impulsivity**

A rating penalty of +3 dB is applicable for impulsivity which is *“just perceptible”*, +6 dB where it is *“clearly perceptible”*, and +9 dB where it is *“highly perceptible”*.

#### **Other Sound Characteristics**

BS4142:2014+A1:2019 states that where *“the specific sound features characteristics that are neither tonal nor impulsive, though otherwise are readily distance against the residual acoustic environment, a penalty of +3 dB can be applied.”*

#### **Intermittency**

BS4142:2014+A1:2019 states that when the *“specific sound has identifiable on/off conditions, the specific sound level ought to be representative of the time period of length equal to the reference*

*time interval which contains the greatest total amount of on time ... if the intermittency is readily distinctive against the residual acoustic environment, a penalty of +3 dB can be applied."*

### 5.2.2. Rating Penalty Assessment

Considering the content of Section 5.2.1, an assessment of the various sound sources associated with the Proposed Development, in terms of whether any rating penalties are applicable, and has been detailed in Table 7 below.

TABLE 7: RATING PENALTY ASSESSMENT

Source	Tonality	Impulsivity	Intermittency	Other Sound Characteristics	Discussion
PV Inverters and Transformers	+2 dB	0 dB	0 dB	0 dB	The PV inverters and transformers will operate as demand requires, however, once operating, do not cycle on and off. Tonality may be <i>"just perceptible"</i> , due to a low-frequency bias at source.
HVAC for Battery Storage	+2 dB	0 dB	0 dB	0 dB	The HVAC for battery storage will operate continuously. Tonality may be <i>"just perceptible"</i> , due to a low-frequency bias at source.

In summary, a rating penalty of +2 dB has been included in the assessment.

### 5.2.3. Uncertainty in Calculations

BS4142:2014+A1:2019 requires that the level of uncertainty in the measured data and associated calculations is considered in the assessment. The Standard recommends that steps should be taken to reduce the level of uncertainty.

#### Measurement Uncertainty

BS4142:2014+A1:2019 states that measurement uncertainty depends on a number of factors, including the following, which are applicable to the Proposed Development:

- “ ...
- b) the complexity and level of variability of the residual acoustic environment;*
  - “ ...
  - d) the location(s) selected for taking the measurements;*
  - “ ...
  - g) the measurement time intervals;*
  - h) the range of times when the measurements have been taken;*
  - i) the range of suitable weather conditions during which measurements have been taken;*
  - “ ...
  - k) the level of rounding of each measurement recorded; and*
  - l) the instrumentation used.”*

Each of the measurement uncertainty factors outlined above have been considered and discussed in Table 8 below.

TABLE 8: MEASUREMENT UNCERTAINTY FACTORS

Measurement Uncertainty Factor Reference	Level of Uncertainty	Discussion
b)	0 dB	Residual acoustic environment is relatively constant, hence no correction for a complex residual acoustic environment.
d)	0 dB	Measuring at locations representative of the closest affected receptors to the site has enabled the determination of robust background sound levels.
g)	0 dB	Measurement time intervals were set in accordance with BS4142:2014+A1:2019, hence no further correction needs to be made.
h)	0 dB	Measurements were undertaken over three consecutive daytime and night-time periods, when road traffic movements were suppressed due to the Covid-19 pandemic.
i)	0 dB	Where periods of wind or precipitation were measured, they were removed from the dataset.
k)	0 dB	Measured values were rounded to 0.1 dB, therefore rounding would not have had a significant impact on the overall typical background sound levels.
l)	0 dB	The acoustic measurement equipment accorded with Type 1 specification of British Standard 61672.

In summary, a correction of 0 dB has been included in the assessment, to account for measurement uncertainty.

## Calculation Uncertainty

BS4142:2014+A1:2019 states that calculation uncertainty depends on a number of factors, including the following, which are applicable to the Proposed Development:

- “ ...
- b) uncertainty in the operation or sound emission characteristics of the specific sound source and any assumed sound power levels;*
  - c) uncertainty in the calculation method;*
  - d) simplifying the real situation to “fit” the model (user influence on modelling); and*
  - e) error in the calculation process.”*

Each of the calculation uncertainty factors outlined above have been considered and discussed in Table 9 below.

TABLE 9: CALCULATION UNCERTAINTY FACTORS

Calculation Uncertainty Factor Reference	Level of Uncertainty	Discussion
b)	0 dB	Sound power levels for all plant are based on manufacturer data.
c)	0 dB	Calculations were undertaken in accordance with ISO 9613-2, which is considered a “ <i>validated method</i> ” by BS4142:2014+A1:2019.
d)	0 dB	The real situation has not been simplified for the purposes of this assessment.
e)	+1 dB	ISO 9613-2 indicates that there is a $\pm 3$ dB accuracy to the prediction method, dependent upon input variables and propagation complexities.

In summary, a +1 dB has been included in the assessment, for calculation uncertainty.

### 5.3. Rating Sound Level

Incorporating the rating penalties detailed in Section 5.2.2 with the predicted specific sound levels, as detailed in Table 6, the rating sound levels have been derived and have been detailed in Table 10 below.

TABLE 10: RATING SOUND LEVELS

NSR	Specific Sound Level (dB)	Rating Sound Level (dB)
1	27	29
2	28	30
3	29	31
4	29	31
5	30	32
6	37	39
7	25	27
8	22	24
9	24	26
10	26	28
11	24	26
12	27	29
13	26	28
14	28	30
15	29	31
16	28	30
17	29	31
18	32	34
19	26	28
20	25	27
21	29	31
22	24	26
23	24	26

### 5.3.1. BS4142:2014+A1:2019 Assessment

The rating sound level, as calculated from the predicted specific sound level, has been assessed in accordance with BS4142:2014+A1:2019, at all NSRs.

The resultant assessment summary, during the daytime period, can be seen in Table 11 below.

TABLE 11: DAYTIME BS4142:2014+A1:2019 ASSESSMENT SUMMARY

NSR	Rating Sound Level (dB)	Uncertainty (dB)	Daytime Background Sound Level (dB)	Excess of Rating over Daytime Background Sound Level (dB)
1	29	+1	51	-21
2	30	+1	51	-20
3	31	+1	51	-19
4	31	+1	51	-19
5	32	+1	51	-18
6	39	+1	51	-11
7	27	+1	58	-30
8	24	+1	58	-33
9	26	+1	58	-31
10	28	+1	40	-11
11	26	+1	40	-13
12	29	+1	40	-10
13	28	+1	40	-11
14	30	+1	40	-9
15	31	+1	40	-8
16	30	+1	40	-9
17	31	+1	42	-10
18	34	+1	42	-7
19	28	+1	42	-13
20	27	+1	42	-14
21	31	+1	39	-7
22	26	+1	39	-12
23	26	+1	39	-12

It can be seen that the Proposed Development is likely to have a 'low impact' at all assessed receptors during the daytime period.

The resultant assessment summary, during the night time period, can be seen in Table 12 below.

TABLE 12: NIGHT TIME BS4142:2014+A1:2019 ASSESSMENT SUMMARY

NSR	Rating Sound Level (dB)	Uncertainty (dB)	Night Time Background Sound Level (dB)	Excess of Rating over Night Time Background Sound Level (dB)
1	29	+1	46	-16
2	30	+1	46	-15
3	31	+1	46	-14
4	31	+1	46	-14
5	32	+1	46	-13
6	39	+1	46	-6
7	27	+1	51	-23
8	24	+1	51	-26
9	26	+1	51	-24
10	28	+1	33	-4
11	26	+1	33	-6
12	29	+1	33	-3
13	28	+1	33	-4
14	30	+1	33	-2
15	31	+1	33	-1
16	30	+1	33	-2
17	31	+1	36	-4
18	34	+1	36	-1
19	28	+1	33	-4
20	27	+1	33	-5
21	31	+1	32	0
22	26	+1	32	-5
23	26	+1	32	-5

It can be seen that the Proposed Development is likely to have a 'low impact' at all assessed receptors during the night-time period.

### 5.3.2. Discussion and Operational Recommendations

The results set out in Section 5.3.1 identify that the operation of the concept layout for the Proposed Development has a low potential to affect the amenity of some of the closest residential receptors to the site, equating to a *No Observed Adverse Effect Level (NOAEL)*.

Furthermore, it is understood that there are a number of Public Right of Ways that pass through the Proposed Development; in all instances, the noise emissions from the inverter stations will be less than the measured ambient sound level in the area, so may be a component of the acoustic character in the future for the Public Right of Ways, but will not be a dominant feature. This phenomenon also equates to *No Observed Adverse Effect Level (NOAEL)*.

For ease of reference, the definition of *No Observed Adverse Effect Level* in PPGNoise is reproduced below:

*"Noise can be heard, but does not cause any change in behaviour, attitude or other physiological response. Can slightly affect the acoustic character of the area but not such that there is a change in the quality of life."*

## 6. CONCLUSION

inacoustic has been commissioned to prepare a Noise Assessment Report for a proposed Solar PV and Battery Storage Project on land to the north east and west of Elstree Aerodrome, Hertfordshire.

Accordingly, this technical noise assessment has been produced to support a Planning Application to Hertsmeire Borough Council. This report details the existing background sound climate at the nearest receptors, as well as the potential sound emissions associated with the development.

The assessment considers the potential noise generation from the plant associated with the Proposed Development, with respect to existing sound levels in the area.

The assessment methodology contained in British Standard 4142:2014+A1:2019 *Method for rating and assessing industrial and commercial sound* has been used in conjunction with supplementary acoustic guidance.

The assessment identifies that the Proposed Development will give rise to rating noise levels that are typically below the measured day and night time background sound levels in the area, at the closest assessed residential receptors, thus giving rise to a Low Impact.

Consequently, the assessment demonstrates that the development will give rise to noise impacts that would be categorised as *No Observed Adverse Effect Level (NOAEL)* within the PPGNoise guidance.

For ease of reference, the definition of *No Observed Adverse Effect Level* in PPGNoise is reproduced below:

*"Noise can be heard, but does not cause any change in behaviour, attitude or other physiological response. Can slightly affect the acoustic character of the area but not such that there is a change in the quality of life."*

Given that, the Development conforms to National and Local Planning Policy requirements; as such, it is recommended that noise should not be a constraint to the approval of this Planning Application.

## 7. APPENDICES

## 7.1. Appendix A – Definition of Terms

Sound Pressure	Sound, or sound pressure, is a fluctuation in air pressure over the static ambient pressure.
Sound Pressure Level (Sound Level)	The sound level is the sound pressure relative to a standard reference pressure of $20\mu\text{Pa}$ ( $20 \times 10^{-6}$ Pascals) on a decibel scale.
Decibel (dB)	A scale for comparing the ratios of two quantities, including sound pressure and sound power. The difference in level between two sounds $s_1$ and $s_2$ is given by $20 \log_{10} (s_1 / s_2)$ . The decibel can also be used to measure absolute quantities by specifying a reference value that fixes one point on the scale. For sound pressure, the reference value is $20\mu\text{Pa}$ .
A-weighting, dB(A)	The unit of sound level, weighted according to the A-scale, which takes into account the increased sensitivity of the human ear at some frequencies.
Noise Level Indices	Noise levels usually fluctuate over time, so it is often necessary to consider an average or statistical noise level. This can be done in several ways, so a number of different noise indices have been defined, according to how the averaging or statistics are carried out.
$L_{eq,T}$	A noise level index called the equivalent continuous noise level over the time period T. This is the level of a notional steady sound that would contain the same amount of sound energy as the actual, possibly fluctuating, sound that was recorded.
$L_{max,T}$	A noise level index defined as the maximum noise level during the period T. $L_{max}$ is sometimes used for the assessment of occasional loud noises, which may have little effect on the overall $L_{eq}$ noise level but will still affect the noise environment. Unless described otherwise, it is measured using the 'fast' sound level meter response.
$L_{90,T}$	A noise level index. The noise level exceeded for 90% of the time over the period T. $L_{90}$ can be considered to be the "average minimum" noise level and is often used to describe the background noise.
$L_{10,T}$	A noise level index. The noise level exceeded for 10% of the time over the period T. $L_{10}$ can be considered to be the "average maximum" noise level. Generally used to describe road traffic noise.
Free-Field	Far from the presence of sound reflecting objects (except the ground), usually taken to mean at least 3.5m
Facade	At a distance of 1m in front of a large sound reflecting object such as a building façade.
Fast Time Weighting	An averaging time used in sound level meters. Defined in BS 5969.

In order to assist the understanding of acoustic terminology and the relative change in noise, the following background information is provided.

The human ear can detect a very wide range of pressure fluctuations, which are perceived as sound. In order to express these fluctuations in a manageable way, a logarithmic scale called the decibel, or dB scale is used. The decibel scale typically ranges from 0 dB (the threshold of hearing) to over 120 dB. An indication of the range of sound levels commonly found in the environment is given in the following table.

TABLE 13: TYPICAL SOUND LEVELS FOUND IN THE ENVIRONMENT

Sound Level	Location
0dB(A)	Threshold of hearing
20 to 30dB(A)	Quiet bedroom at night
30 to 40dB(A)	Living room during the day
40 to 50dB(A)	Typical office
50 to 60dB(A)	Inside a car
60 to 70dB(A)	Typical high street
70 to 90dB(A)	Inside factory
100 to 110dB(A)	Burglar alarm at 1m away
110 to 130dB(A)	Jet aircraft on take off
140dB(A)	Threshold of Pain

The ear is less sensitive to some frequencies than to others. The A-weighting scale is used to approximate the frequency response of the ear. Levels weighted using this scale are commonly identified by the notation dB(A).

In accordance with logarithmic addition, combining two sources with equal noise levels would result in an increase of 3 dB(A) in the noise level from a single source.

A change of 3 dB(A) is generally regarded as the smallest change in broadband continuous noise which the human ear can detect (although in certain controlled circumstances a change of 1 dB(A) is just perceptible). Therefore, a 2 dB(A) increase would not normally be perceptible. A 10 dB(A) increase in noise represents a subjective doubling of loudness.

A noise impact on a community is deemed to occur when a new noise is introduced that is out of character with the area, or when a significant increase above the pre-existing ambient noise level occurs.

For levels of noise that vary with time, it is necessary to employ a statistical index that allows for this variation. These statistical indices are expressed as the sound level that is exceeded for a percentage of the time period of interest. In the UK, traffic noise is measured as the  $L_{A10}$ , the noise level exceeded for 10% of the measurement period. The  $L_{A90}$  is the level exceeded for 90% of the time and has been adopted to represent the background noise level in the absence of discrete events. An alternative way of assessing the time varying noise levels is to use the equivalent continuous sound level,  $L_{Aeq}$ .

This is a notional steady level that would, over a given period of time, deliver the same sound energy as the actual fluctuating sound.

To put these quantities into context, where a receiver is predominantly affected by continuous flows of road traffic, a doubling or halving of the flows would result in a just perceptible change of 3 dB, while an increase of more than 25%, or a decrease of more than 20%, in traffic flows represent changes of 1 dB in traffic noise levels (assuming no alteration in the mix of traffic or flow speeds).

Note that the time constant and the period of the noise measurement should be specified. For example, BS 4142 specifies background noise measurement periods of 1 hour during the day and 15 minutes during the night. The noise levels are commonly symbolised as  $L_{A90,1\text{hour}}$  dB and  $L_{A90,15\text{mins}}$  dB. The noise measurement should be recorded using a 'FAST' time response equivalent to 0.125 ms.

## 7.2. Appendix B - Full Measurement Results

FIGURE 5: MP1 - MEASURED TIME HISTORY

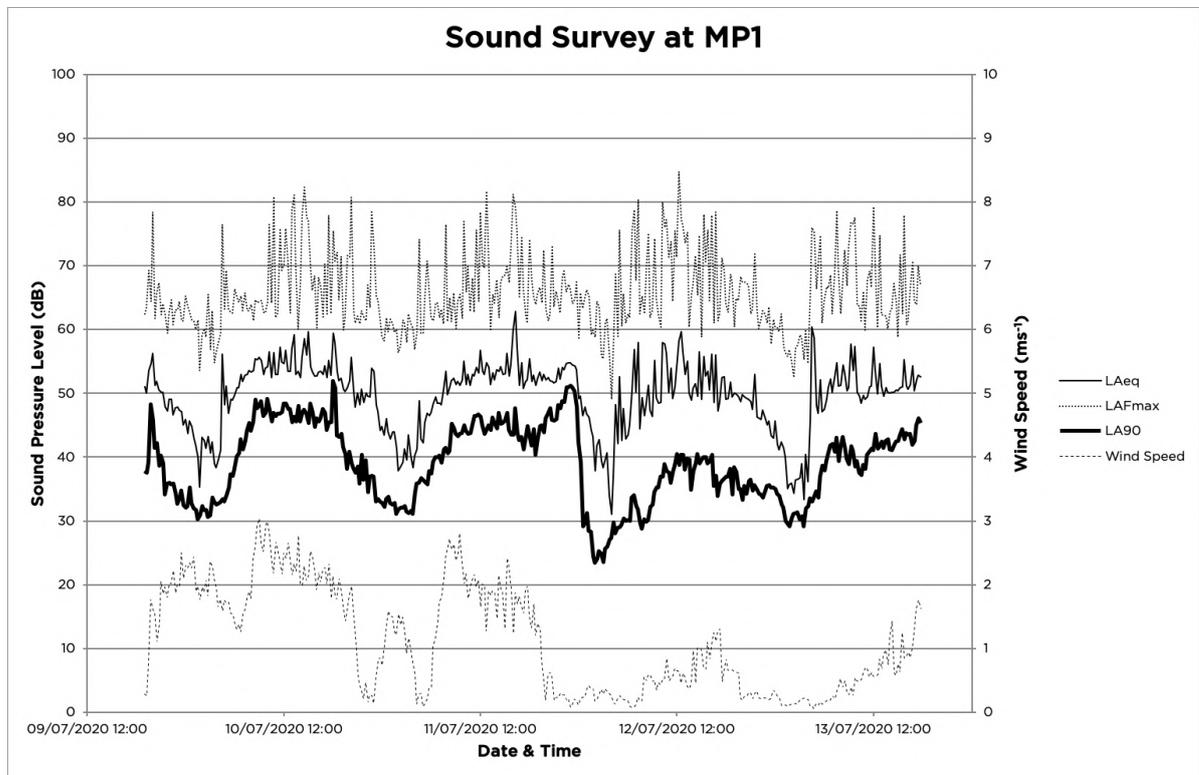


FIGURE 6: MP1 - STATISTICAL ANALYSIS OF  $L_{A90}$  BACKGROUND - DAYTIME

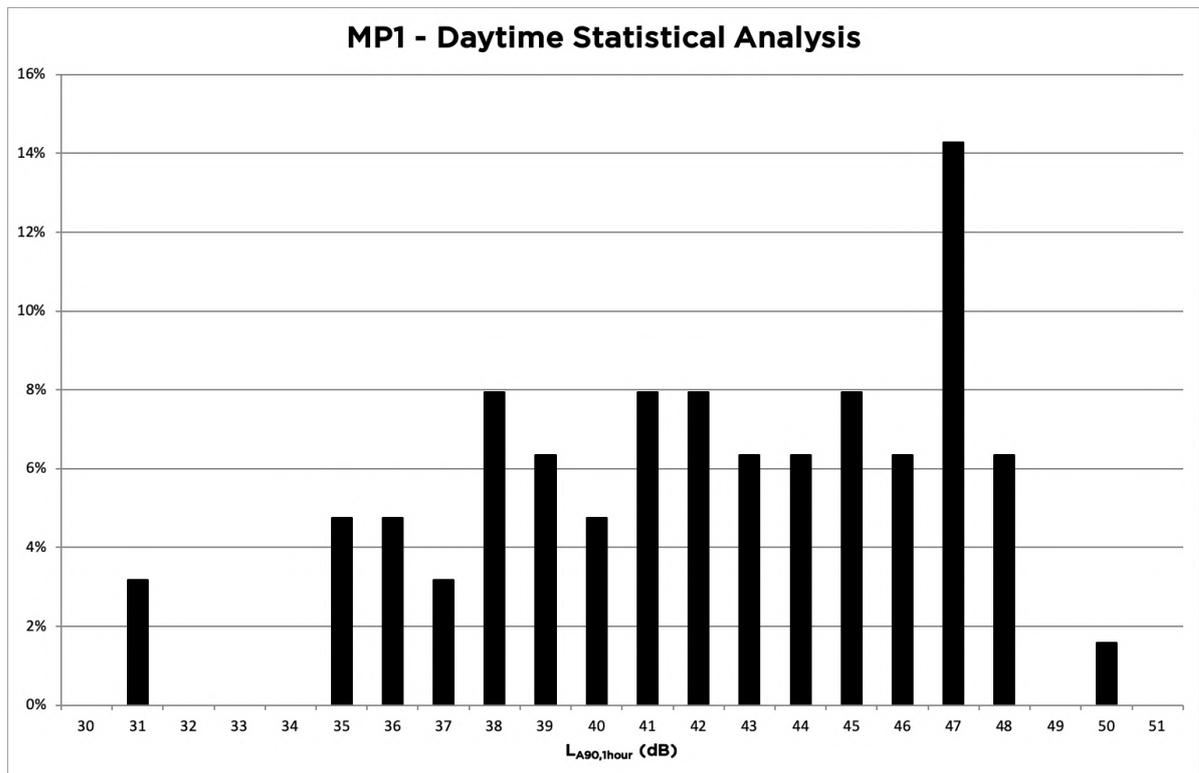


FIGURE 7: MP1 - STATISTICAL ANALYSIS OF  $L_{A90}$  BACKGROUND - NIGHT-TIME

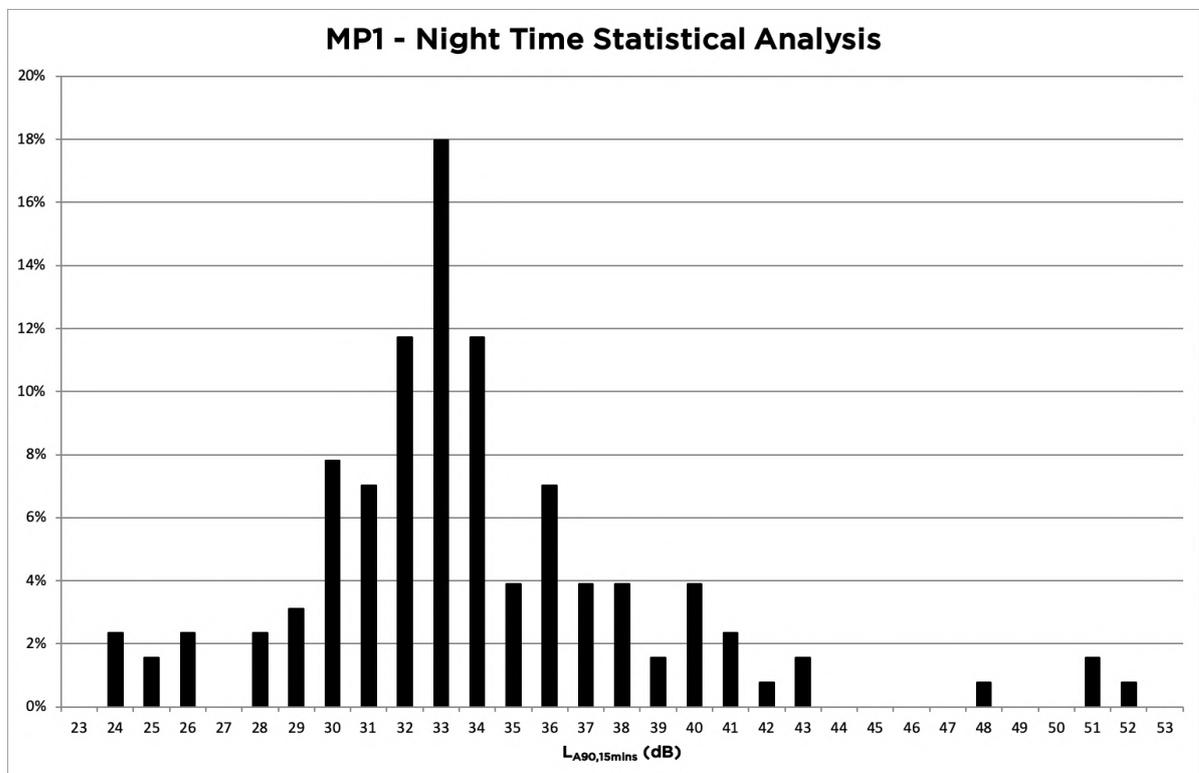


FIGURE 8: MP2 - MEASURED TIME HISTORY

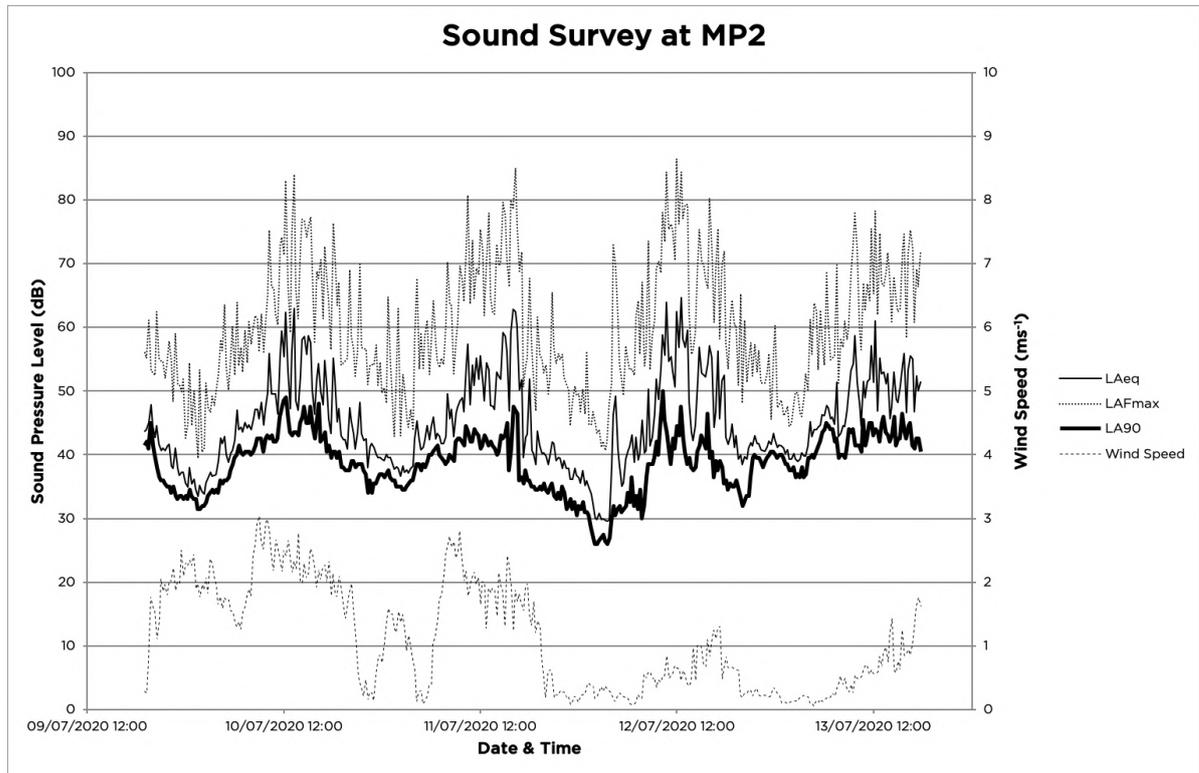


FIGURE 9: MP2 - STATISTICAL ANALYSIS OF L<sub>A90</sub> BACKGROUND - DAYTIME

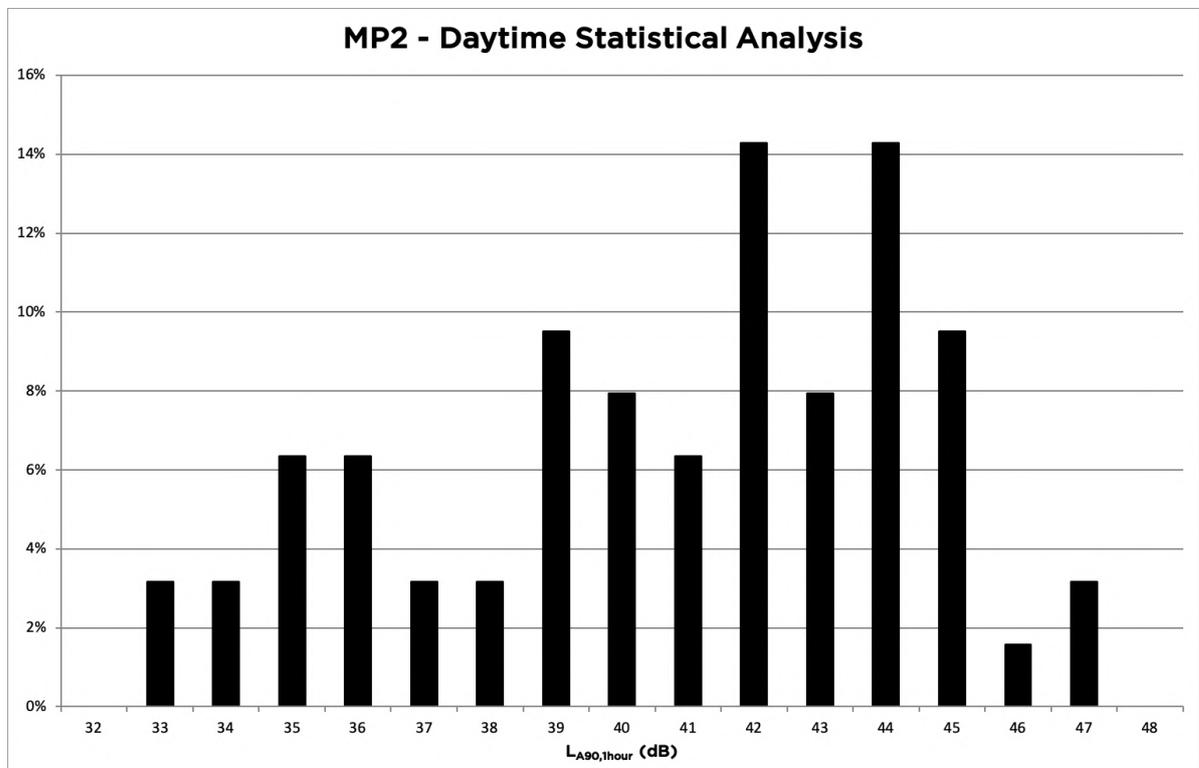


FIGURE 10: MP2 - STATISTICAL ANALYSIS OF  $L_{A90}$  BACKGROUND - NIGHT-TIME

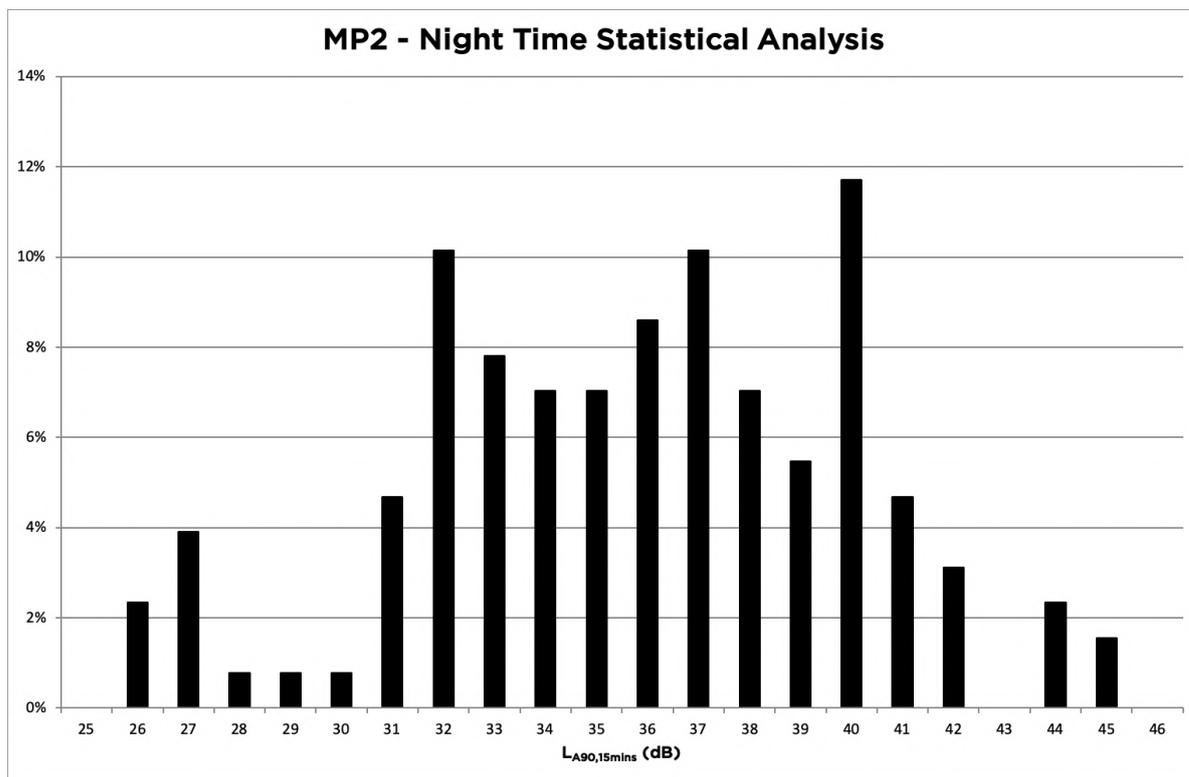


FIGURE 11: MP3 - MEASURED TIME HISTORY

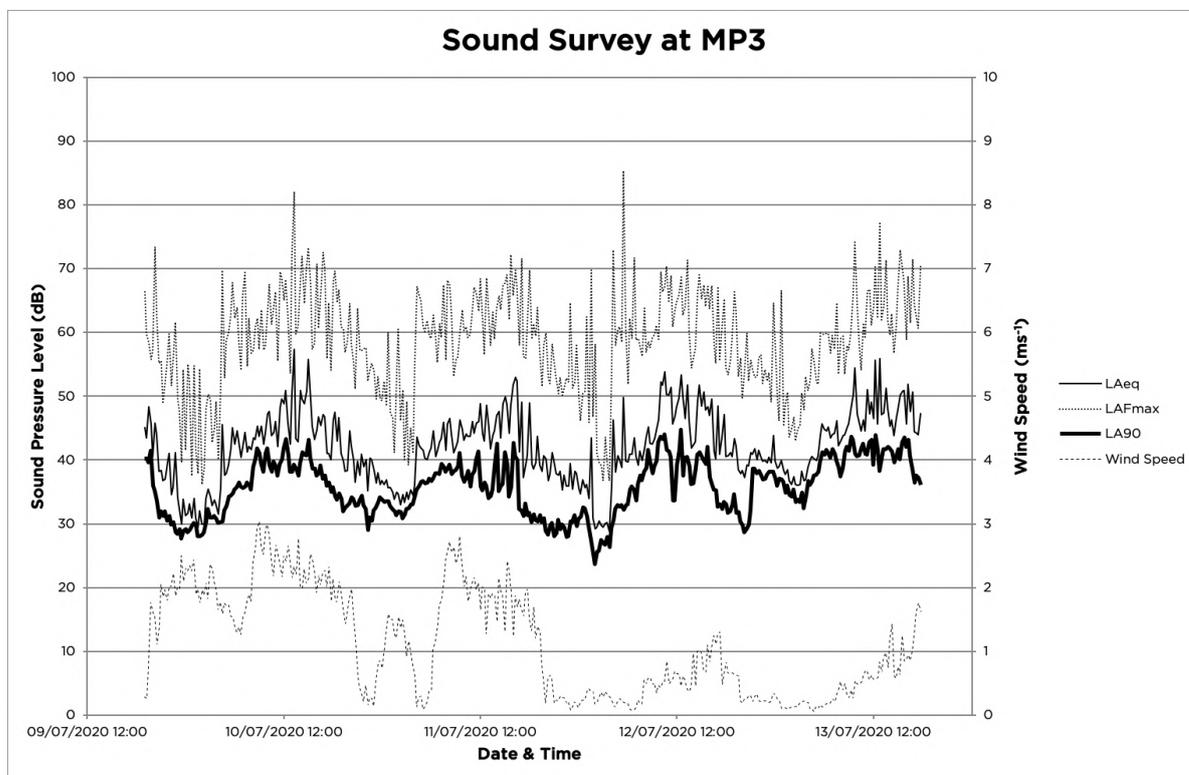


FIGURE 12: MP3 - STATISTICAL ANALYSIS OF  $L_{A90}$  BACKGROUND - DAYTIME

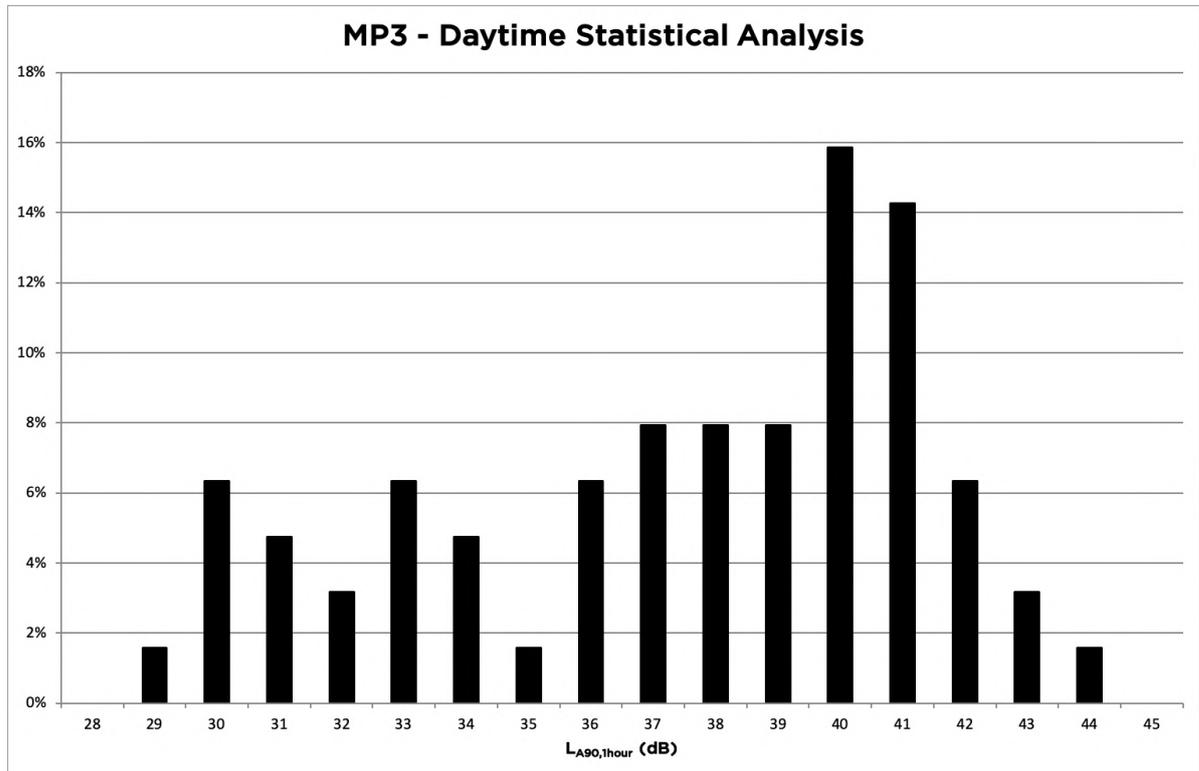


FIGURE 13: MP3 - STATISTICAL ANALYSIS OF  $L_{A90}$  BACKGROUND - NIGHT-TIME

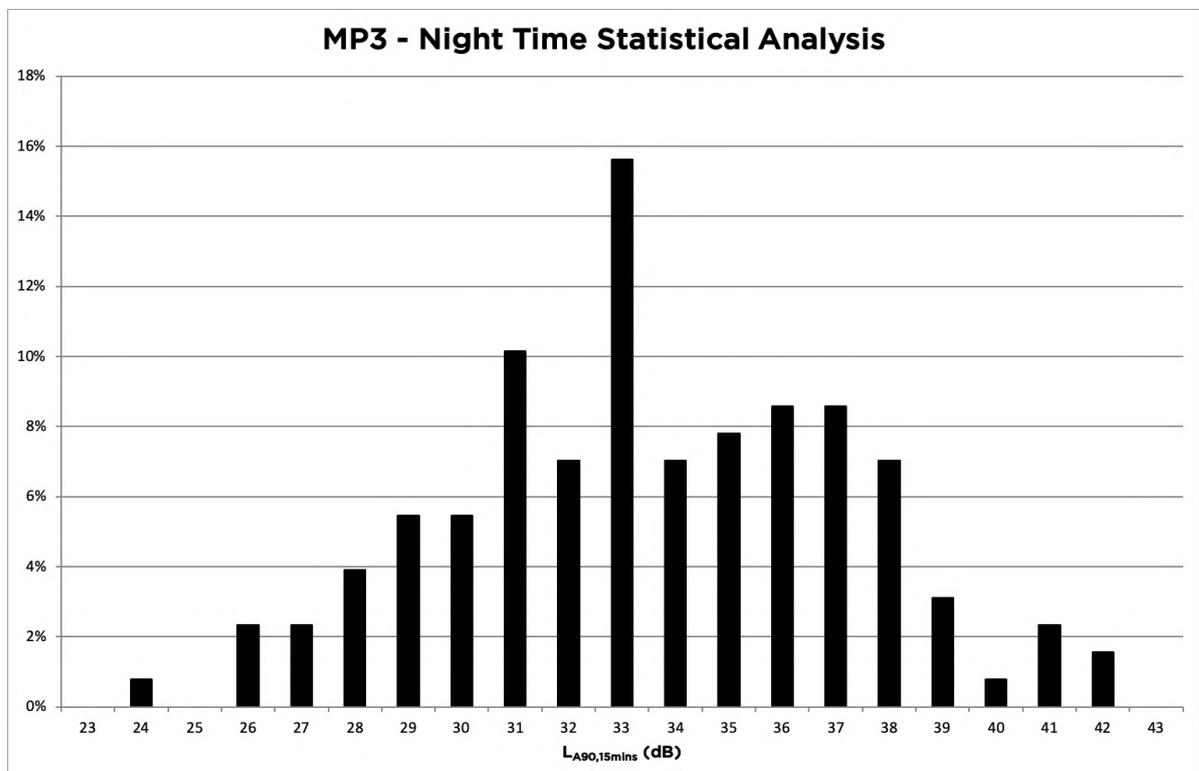


FIGURE 14: MP4- MEASURED TIME HISTORY

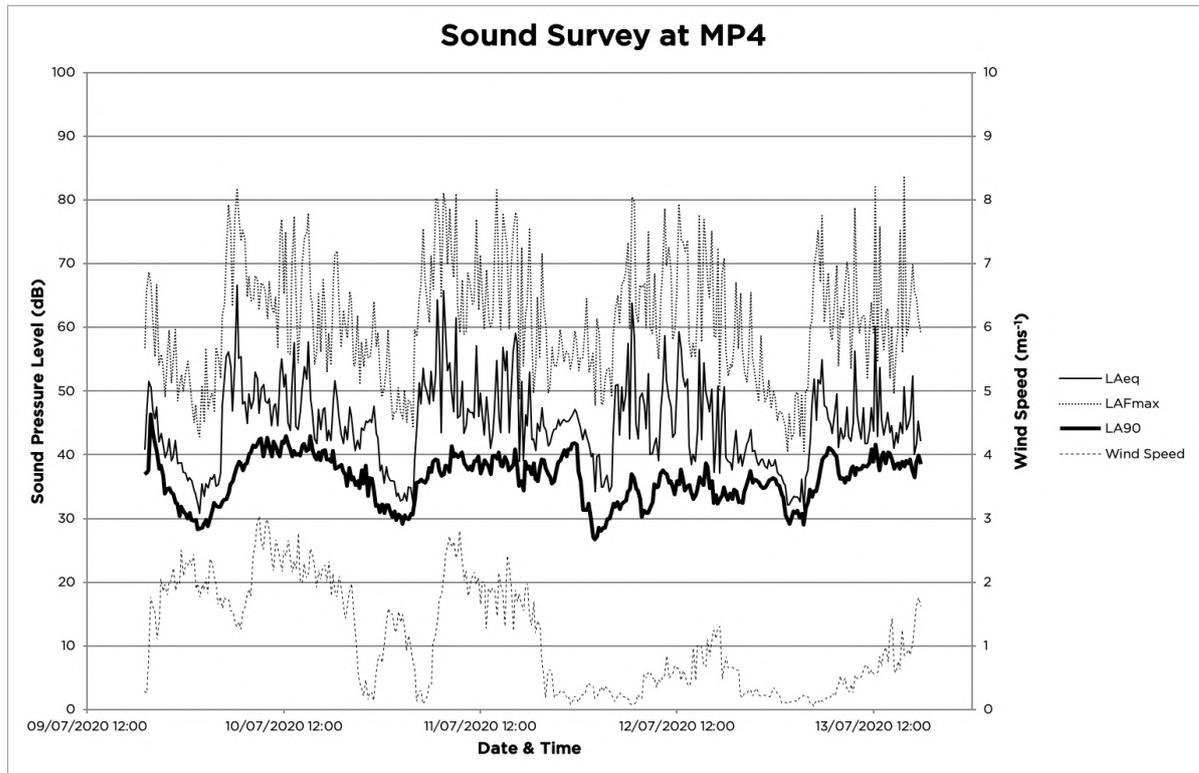


FIGURE 15: MP4 - STATISTICAL ANALYSIS OF LA90 BACKGROUND - DAYTIME

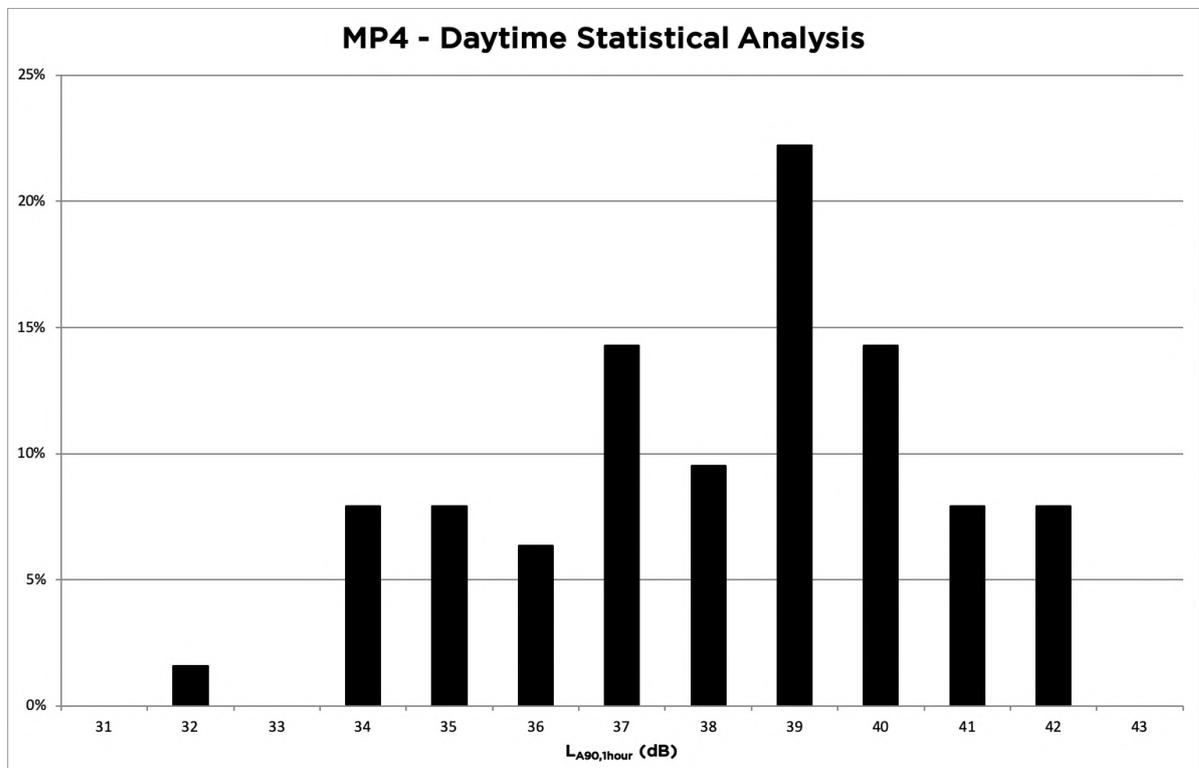


FIGURE 16: MP4 - STATISTICAL ANALYSIS OF  $L_{A90}$  BACKGROUND - NIGHT-TIME

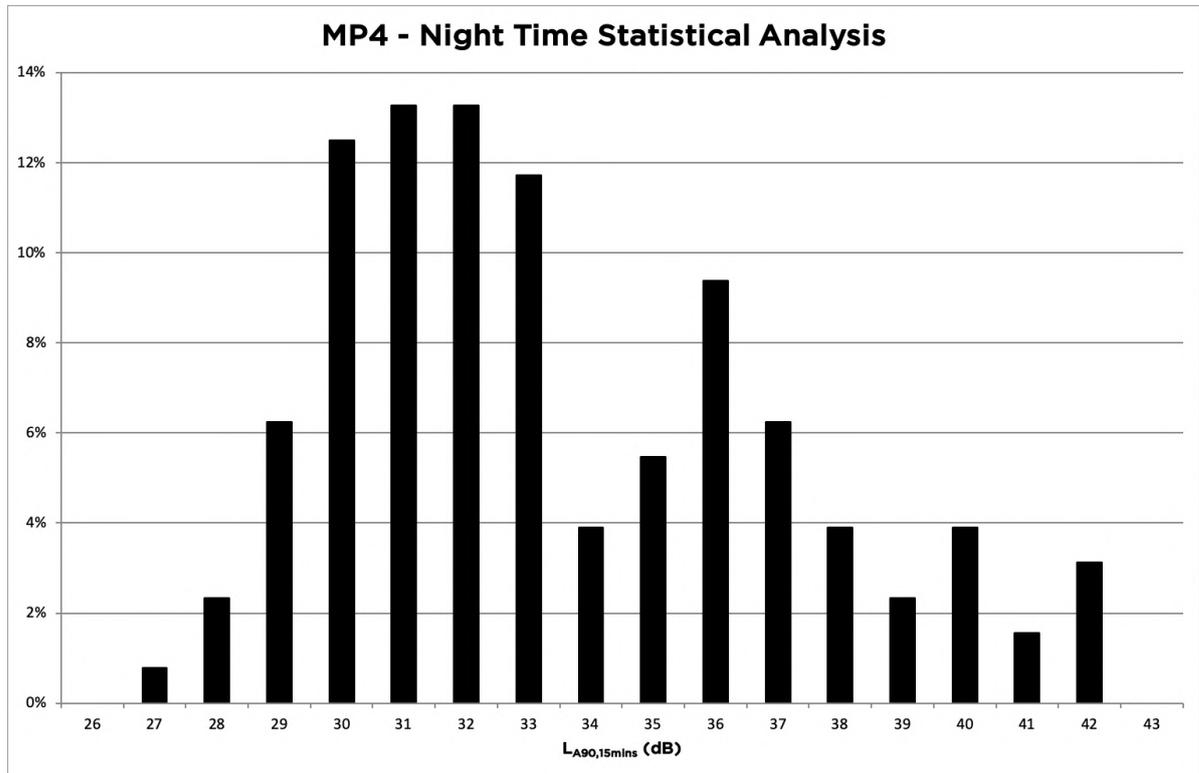


FIGURE 17: MP5 - MEASURED TIME HISTORY

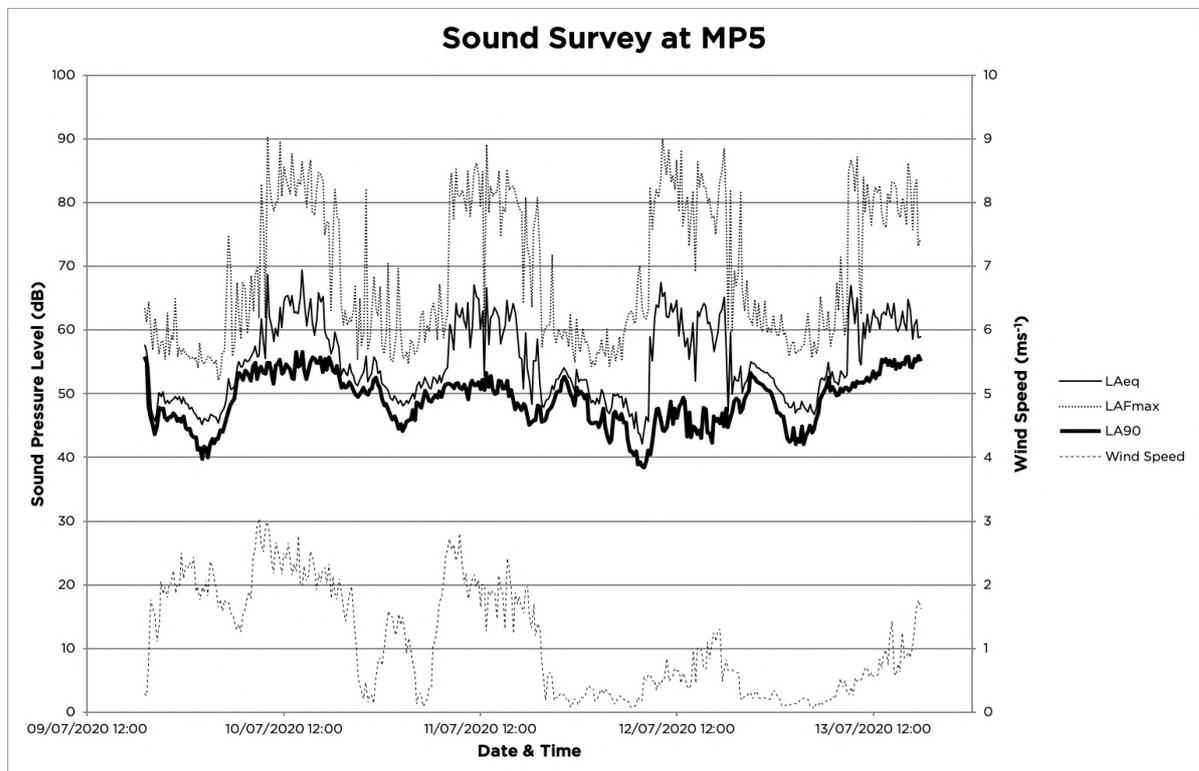


FIGURE 18: MP5 - STATISTICAL ANALYSIS OF  $L_{A90}$  BACKGROUND - DAYTIME

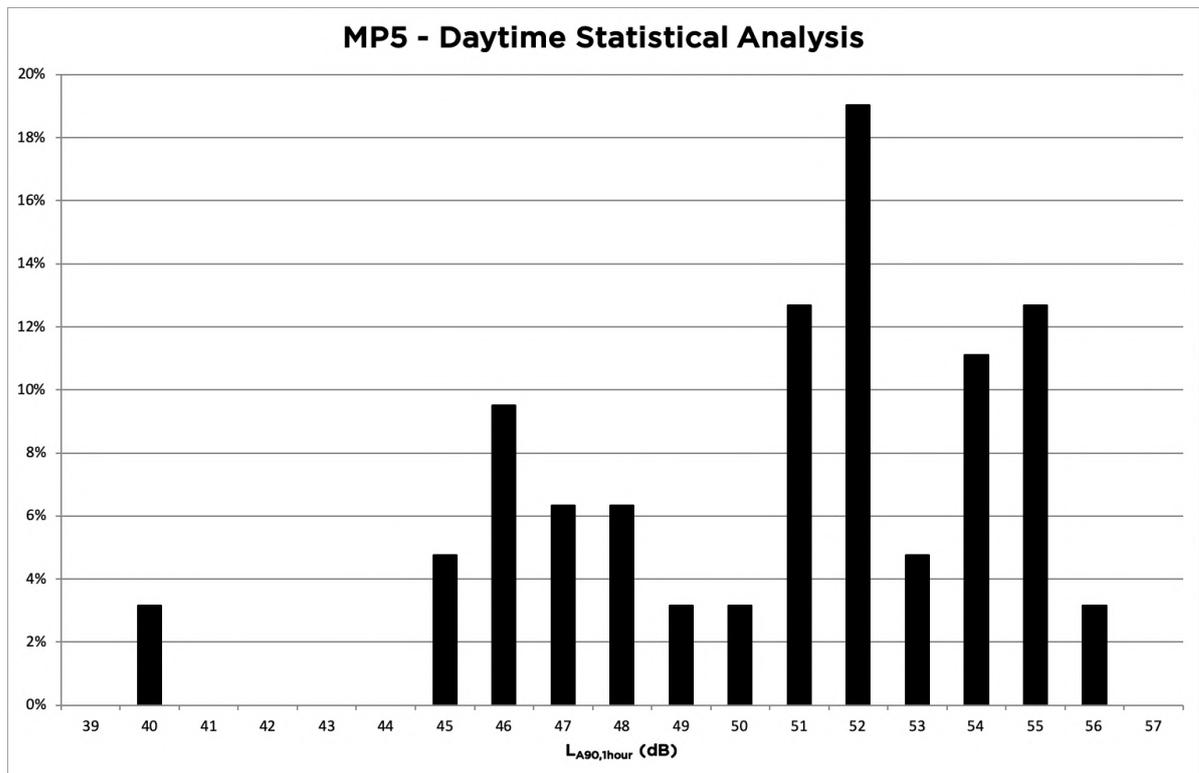


FIGURE 19: MP5 - STATISTICAL ANALYSIS OF  $L_{A90}$  BACKGROUND - NIGHT-TIME

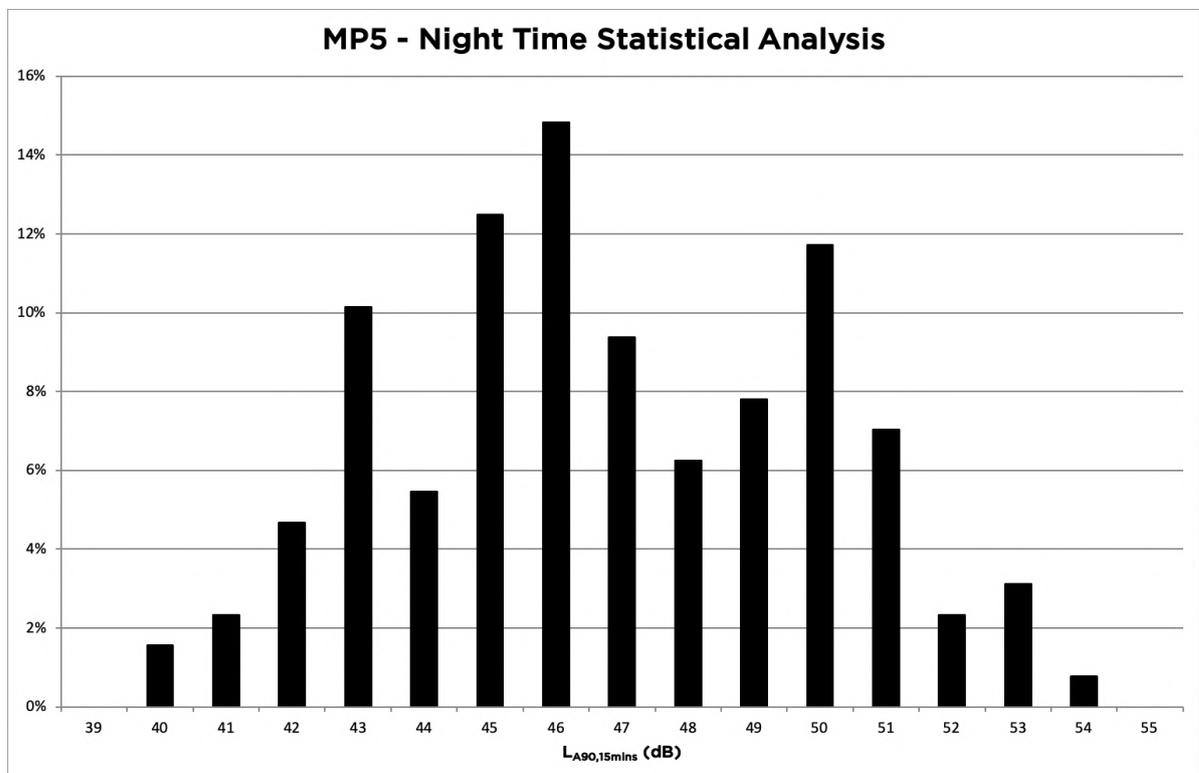


FIGURE 20: MP6 - MEASURED TIME HISTORY

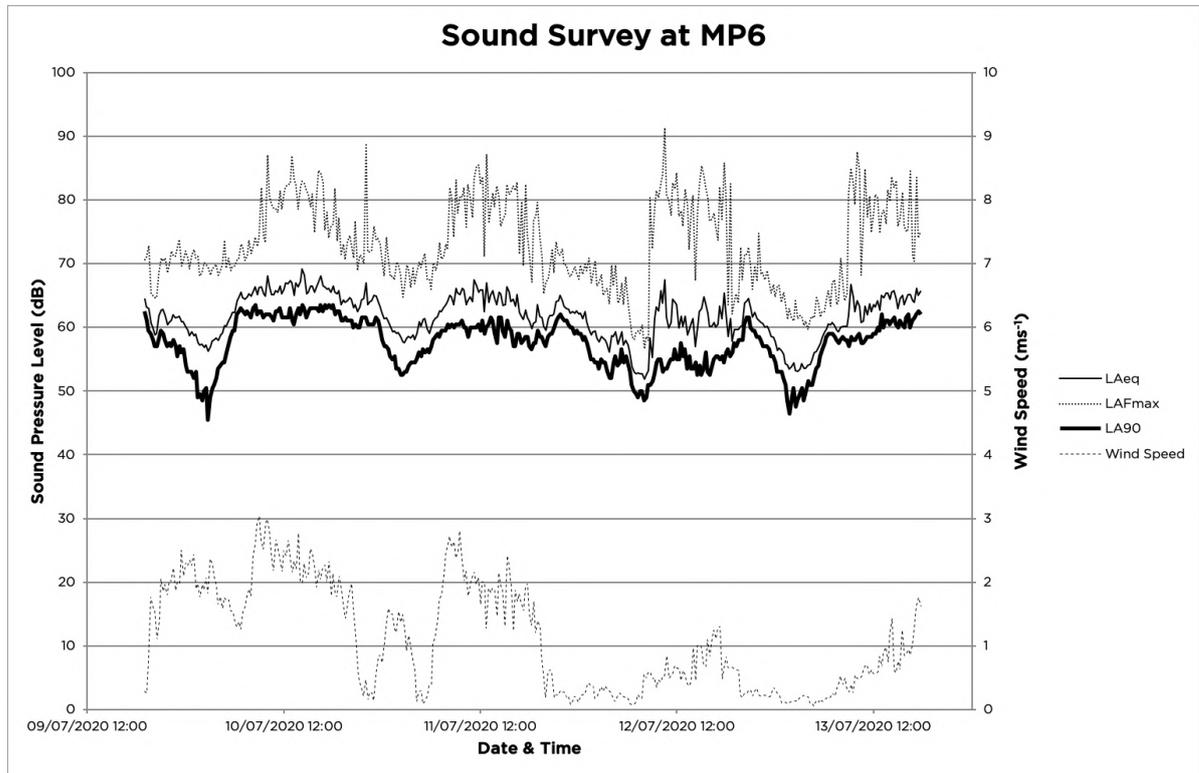


FIGURE 21: MP6 - STATISTICAL ANALYSIS OF LA90 BACKGROUND - DAYTIME


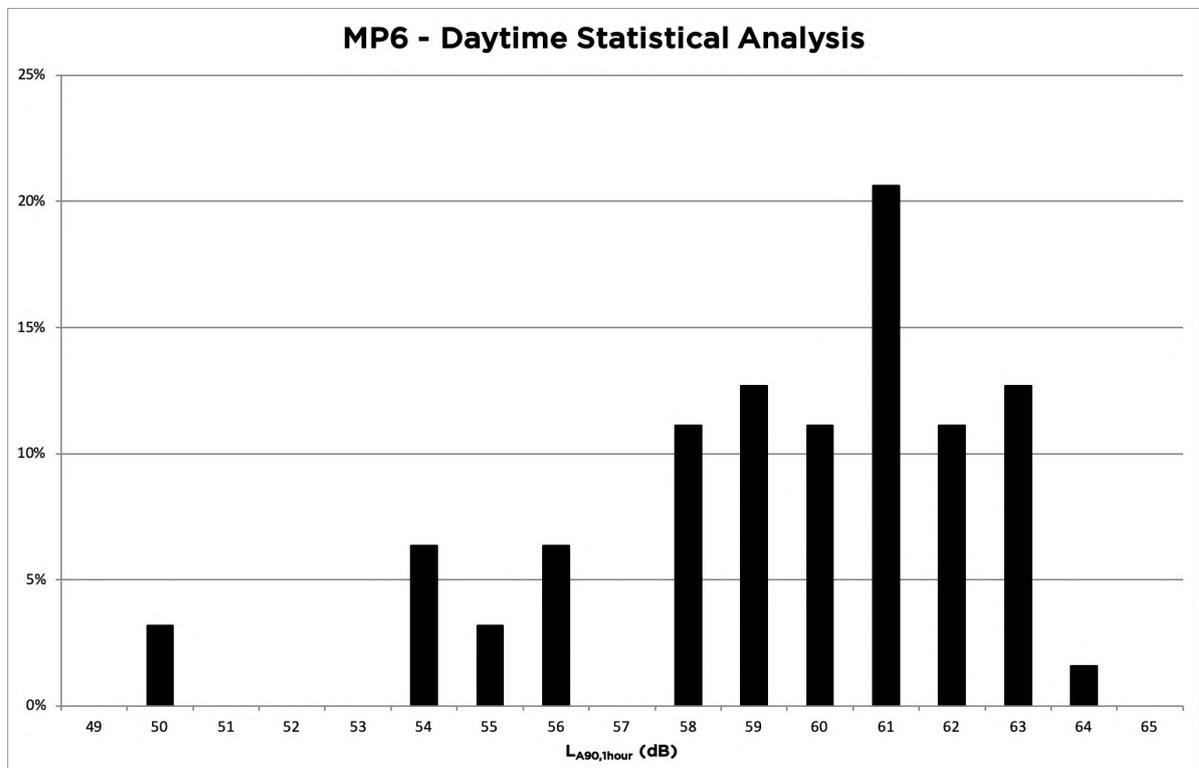


FIGURE 22: MP6 - STATISTICAL ANALYSIS OF  $L_{A90}$  BACKGROUND - NIGHT-TIME

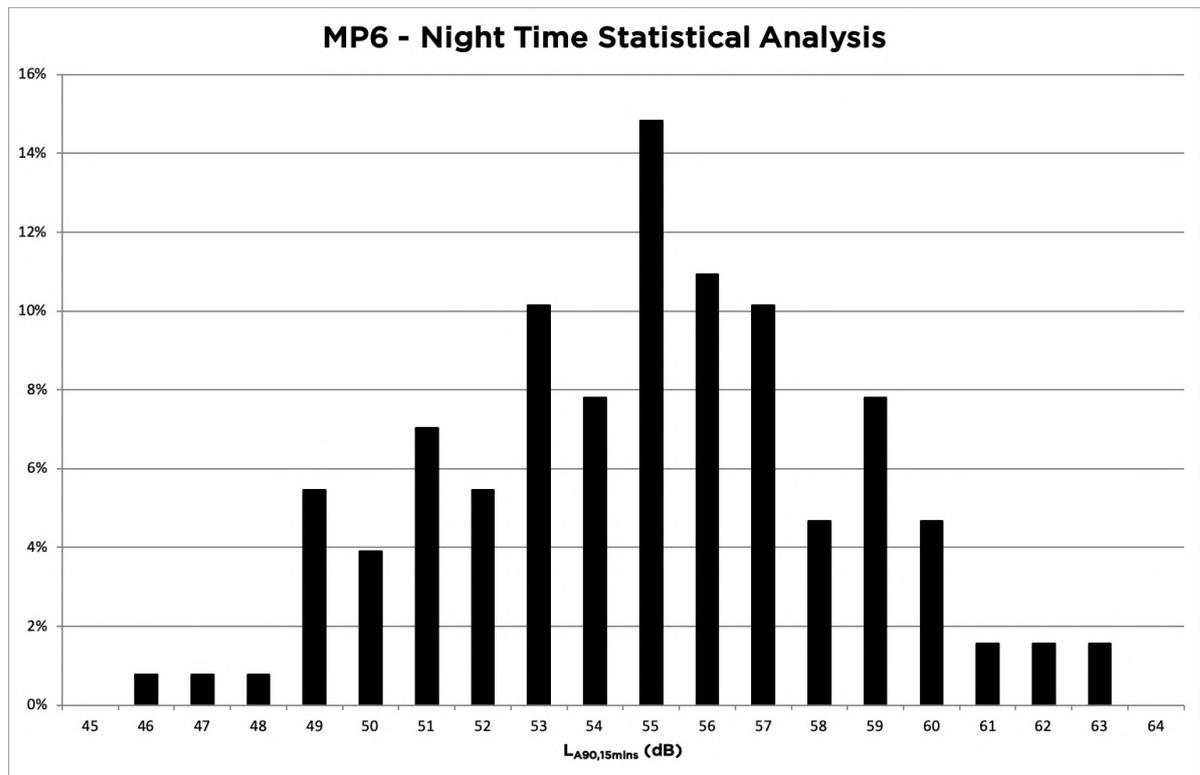

inacoustic | **bristol**

Caswell Park, Caswell Lane, Clapton-in-Gordano, Bristol, BS20 7RT

0117 325 3949 | [www.inacoustic.co.uk](http://www.inacoustic.co.uk) | [bristol@inacoustic.co.uk](mailto:bristol@inacoustic.co.uk)

inacoustic is a trading name of ABRW Associates Ltd, registered in the UK 09382861